




Installing Select Material around the Pump Station No. 30 Meter Vault and Wet Well



Performing Test Run of Pump Station No. 30

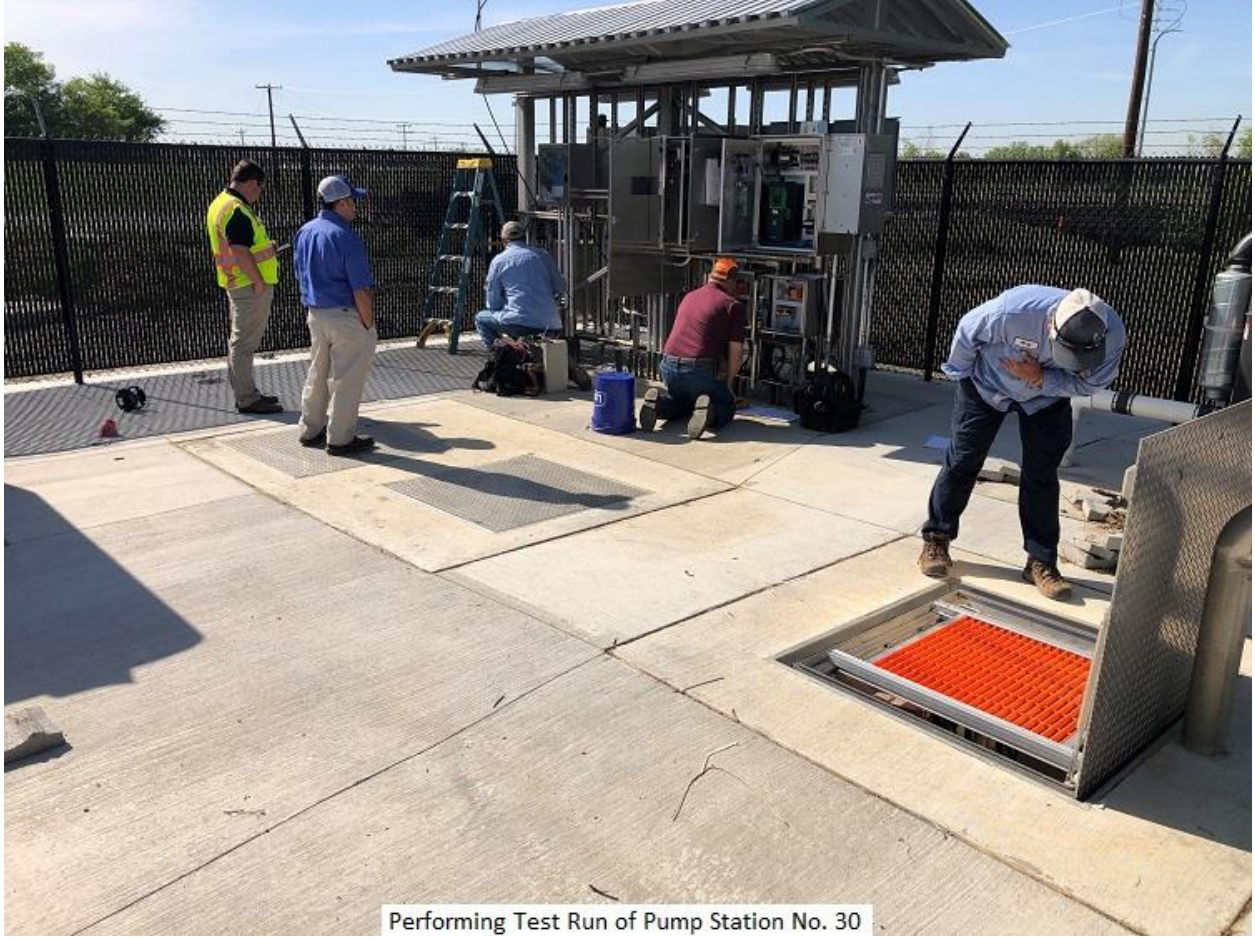

Yard Hydrant, RPZ Backflow Preventer, and Electrical Rack Frame Installed at PS 30



Installing Electrical Conduits for the Equipment Pads at Pump Station No. 30 (PS 30)



Installing Air Release Valves along Riverfront Drive



Installing the 12-Inch Ductile Iron Water Line on the North Side of North P Street